



The EU F-gas Regulation Revision

What does it mean for your business?



Refrigerants are an integral part of heat pump and air conditioning technology. Like our systems and products, refrigerants have also continually evolved to adapt to new requirements for efficiency and, above all, environmental protection.

This leaflet aims give you an **insight in Daikin's refrigerant strategy** for the European market and more background on the **F-gas Regulation** so you can confidently prepare for the future.




What is the EU F-gas Regulation?

The EU F-gas Regulation is a set of rules within the European Union designed to control and reduce the consumption of hydrofluorocarbons (HFCs) in Europe. The regulation encourages using more sustainable alternatives, such as lower global warming potential (GWP) refrigerants and re-use practices, to mitigate climate change. The latest revision came into force on 11 March 2024.

Key elements of the 2024 EU F-gas Revision

- A stricter phase-down path from 2025 onwards and a phase-out of virgin HFCs by 2050
- Stricter GWP limits for specific types of products (see page 5), with post-2030 limits subject to possible review
- Products placed on the market before a GWP limit comes into force can continue to be sold, installed, operated and serviced throughout their entire lifetime (see page 6)

Stricter F-gas Regulation phase down (tonnes CO₂ equivalent)

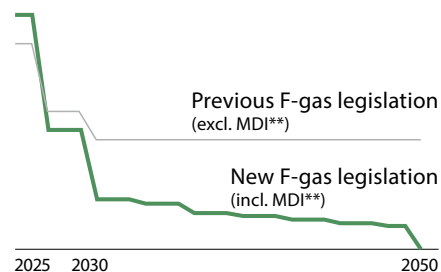

** scope has changed, the MDI (metered dose inhalers) sector is now also in scope of the HFC phase down

Find **more information** and access to our **frequently asked questions** on our F-gas web page!















F-gas phase down – a phased approach

While introducing GWP limits, the EU clearly indicates that different applications move at different speeds of transition.

Smaller self-contained and split systems with lower refrigerant charges, as well as chillers, are the first ones to move below the 150 GWP limit, from 2027 onwards. For larger systems the change is expected later towards 2030 or beyond.

Review date

In 2030, there will be an evaluation by the EU Commission to determine whether the post-2030 product bans are feasible. Depending on this report, amendments are still possible to bans taking effect after 2030.

		Review date ↓						
		2024	2025	2026	2027	2028	2029	2030
AC & HPs		Air-to-air splits	No GWP limit	GWP 750 (single split < 3 kg*)				GWP 150
		Air-to-water splits	No GWP limit	GWP 750 (single split < 3 kg*)	GWP 150			
		Air-to-air & air-to-water splits	No GWP limit	GWP 750 (single split < 3 kg*)				GWP 750
Self-contained systems & chillers		≤ 12 kW	No GWP limit	GWP 150				
		> 12 kW ≤ 50 kW	No GWP limit	GWP 150				
		Self-contained AC & HPs > 50 kW	No GWP limit					GWP 150
		≤ 12 kW	No GWP limit	GWP 150				
		Chillers (cooling only) > 12 kW	No GWP limit	GWP 750				
Refrigeration		Fridges/freezers for commercial use (self-contained)	GWP 150					
		Other self-contained refrigeration equipment	GWP 150					
		All other stationary refrigeration equipment	GWP 2,500 (except equipment temperature < -50 °C)					GWP 150
		Mobile refrigeration	No prohibition for placing on the market of mobile refrigeration					

* Existing ban from 2014 F-gas regulation applicable to both air-to-air and air-to-water single splits. Above 3 kg refrigerant: no GWP limit

Watch the **complete overview** on product bans on our F-gas web page!



Our strategy: a balanced refrigerant choice per application

There is no one-size-fits-all refrigerant, as different applications present different challenges.

Daikin's strategy is to choose the ideal refrigerant for each application by balancing safety, energy efficiency, environmental impact and cost over the entire life cycle of a product, always in line with current regulations.



Environmental impact

- Lower global warming potential
- In line with the F-gas Regulation GWP bans and quota phase down




Safety

- Related to transport, storage, installation, recovery & recycling
- Toxicity or flammability characteristics for application



Future readiness

- Contribute to reducing overall system operation and maintenance costs
- Potential to be recycled and reused




















Affordability

- Ease of installation
- Cost of equipment and safety precautions

Refrigerant outlook for Europe

In order to meet a wide range of safety and performance requirements and to continue to drive the decarbonisation of the building sector, different refrigerants (fluorinated and non-fluorinated) are needed. In the table below you can find our most important future refrigerants for Europe.

Refrigerant	R-32	R-290	R-454C	R-744 (CO ₂)
 GWP	675	0.02*	145.5*	1
 Energy efficiency	+++	+++	+++	++
 Safety	 <ul style="list-style-type: none"> ▪ Lower flammable (A2L) ▪ Refrigerant and hydrosplit connection possible ▪ Suitable in all applications 	   <ul style="list-style-type: none"> ▪ Highly flammable (A3) ▪ Limitations based on refrigerant amount ▪ Suitable only in special applications 	 <ul style="list-style-type: none"> ▪ Lower flammable (A2L) ▪ Refrigerant and hydrosplit connection possible 	 <ul style="list-style-type: none"> ▪ Not flammable (A1) ▪ Suitable in all applications ▪ High pressure
 Affordability		  <ul style="list-style-type: none"> ▪ Additional safety precautions ▪ Bigger dimensions to keep efficiency 	  <ul style="list-style-type: none"> ▪ More materials required ▪ Bigger dimensions to keep efficiency 	  <ul style="list-style-type: none"> ▪ More materials required
Recommended applications	All	Residential and light commercial applications, self-contained refrigeration		Commercial applications, other refrigeration equipment

* GWP values in accordance with revised F-gas Regulation (EU 2024/573)

Sit back and relax: Daikin takes care of the products

The F-gas Regulation has raised questions for many, like “What do I need to pay attention to?” and “How do I ensure that the products can be installed?”

At Daikin, we handle these concerns by ensuring that **every product we offer fully complies with the regulation**. This means that the products we offer you can be sold, operated, maintained and repaired till the end of their lifetime, without any worries.

Daikin's portfolio is ready The right refrigerant for the right application

	Daikin product group	Transition away from	→ Future-proof today's installations	→ Next-generation technology
Air to air	Split / Sky Air	R-410A GWP: 2,087.5	R-32 GWP: 675	R-290 GWP: 0.02 R-454C GWP: 145.5 R-744 GWP: 1
	VRV	R-410A GWP: 2,087.5	R-32 GWP: 675	R-744 GWP: 1
Air to water	Daikin Altherma	R-410A GWP: 2,087.5	R-32 GWP: 675	R-454C GWP: 145.5 R-290 GWP: 0.02
	Chillers and heat pumps	R-410A GWP: 2,087.5 R-134a GWP: 1,430	R-32 GWP: 675	R-290 GWP: 0.02 R-454C GWP: 145.5
Cold chain refrigeration	Commercial refrigeration	R-410A GWP: 2,087.5 R-448A GWP: 1,386 R-449A GWP: 1,396.2 R-134a GWP: 1,430	R-290 GWP: 0.02 R-744 GWP: 1	R-290 GWP: 0.02 R-744 GWP: 1
	Industrial refrigeration	Different A1 and A2L refrigerants	R-744 GWP: 1 R-717 GWP: 0	R-744 GWP: 1 R-717 GWP: 0
	Transport refrigeration	R-134a GWP: 1,430 R-404A GWP: 3,921.6	R-452A GWP: 2,139.4	R-290 GWP: 0.02 R-744 GWP: 1

Find out more about **our outlook
on refrigerants** in Europe here!






Sales, maintenance and repair of products

A ban of certain refrigerants doesn't mean a complete ban on selling, installing and operating systems.

- All concerned **equipment already placed on the market** (in stock by Daikin, wholesalers or installers) prior to the start of a ban **can still be sold out**.
- If it is not possible to install a compliant system for **safety reasons** at the site of installation, the ban does not apply.
- Daikin **spare parts and technical support** are guaranteed for the lifetime of the systems.

You can still sell, operate, maintain and repair products after the ban

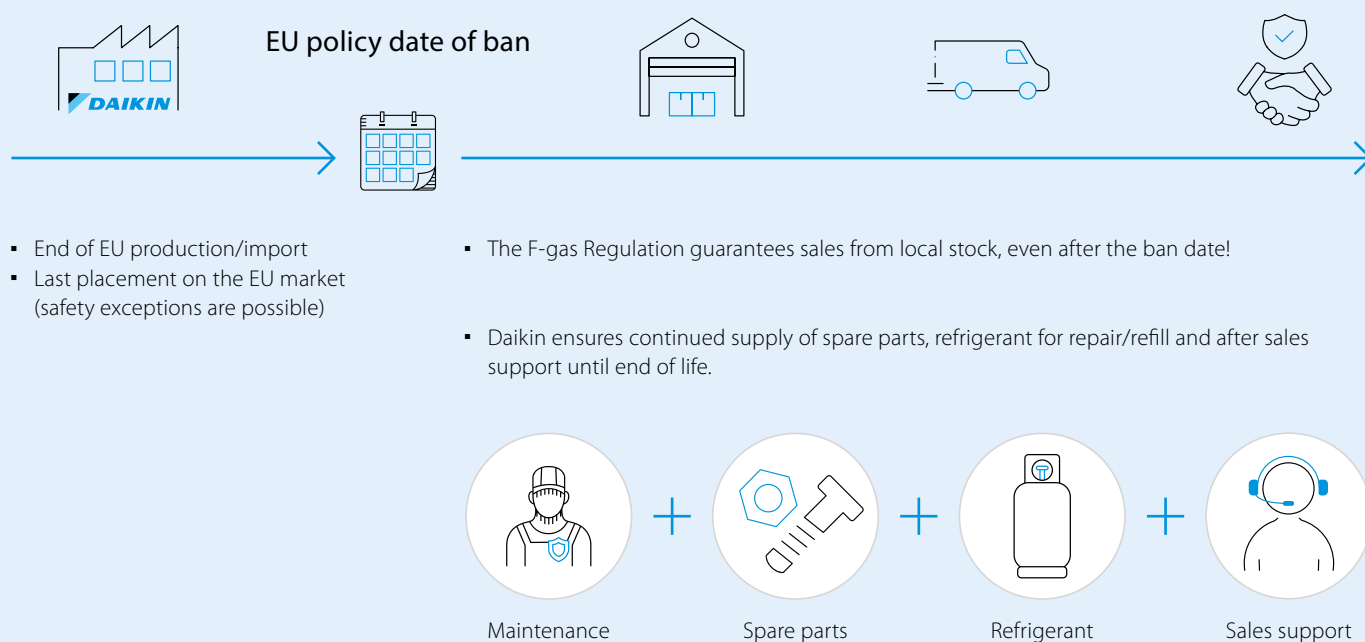


Find out more details about **servicing & maintenance** of products here



Leak checks

Leak checks are an important part of the revised F-gas Regulation and are essential when handling refrigerants. Below you can find the latest information and guidance.



General guidelines

NEW In addition to the known limits for HFC refrigerants for carrying out leak checks, leak checks must now be carried out for filling quantities of 1 kg HFO refrigerant or more (2 kg for hermetically sealed systems).

NEW From now on, leak tests must be carried out on chillers with the refrigerant R-1234ze with a filling quantity of ≥ 1 kg. The specialist company carrying out the inspection must also have a F-gas certification.

Exception: For hermetically sealed devices installed in residential buildings, no leak checks need to be carried out if the filling quantity is < 3 kg.

Type of refrigerant	Refrigerant charge	Prescribed frequency of leak checks	
		Without leak detection system	With leak detection system
HFC	$< 5 \text{ tCO}_2\text{eq}$	No check needed	No check needed
	$\geq 5 \text{ tCO}_2\text{eq}$ (hermetically sealed facilities: $\geq 10 \text{ tCO}_2\text{eq}$), $< 50 \text{ tCO}_2\text{eq}$	Every 12 months	Every 24 months
	$\geq 50 \text{ tCO}_2\text{eq}$, $< 500 \text{ tCO}_2\text{eq}$	Every 6 months	Every 12 months
	$\geq 500 \text{ tCO}_2\text{eq}$	Not allowed*	Every 6 months
HFO	$< 1 \text{ kg}$	No check needed	No check needed
	$\geq 1 \text{ kg}$ (hermetically sealed facilities: $\geq 2 \text{ kg}$), $< 10 \text{ kg}$	Every 12 months	Every 24 months
	$\geq 10 \text{ kg}$, $< 100 \text{ kg}$	Every 6 months	Every 12 months
	$\geq 100 \text{ kg}$	Not allowed*	Every 6 months

* Leak detection system required for refrigeration, air conditioning, heat pumps and fire protection equipment



The revised F-gas Regulation requires checking each component of an HFC/HFO blend individually. Whichever leak check requirement is reached first defines the requirement.

Example for R-454C (GWP: 145.5)

- Composition: R-32 (21.5%) + R-1234yf (78.5%)
- HFC: leak check needed from 5 tonnes CO_2eq onwards – $7.4 \text{ kg of R-32} = 34.4 \text{ kg of R-454C}$
- HFO: leak check needed from 1 kg onwards – $1 \text{ kg of R-1234yf} = 1.3 \text{ kg of R-454C}$

→ HFO threshold is reached first

→ Leak check needed from 1.3 kg onwards

Specifications after repair

As before, the final leak test after a repaired leak must be carried out **within one month of the repair**.

NEW The **minimum time interval** between repair and the final leak test must now be **at least 24 hours** (previously the test could be carried out directly after the repair).


This regulation applies immediately to all systems, regardless of the type of refrigerant, after repairing a leak.

Supporting decarbonisation

It is in our DNA to provide safe, healthy and comfortable spaces throughout the building life cycle using world-leading technology. Driven by a dedication to achieve net zero CO₂ emissions by 2050, we work together with our partners and customers in helping to create a world with healthier indoor air and minimal environmental impact.



Daikin actions to reduce CO₂ equivalent impact of our systems

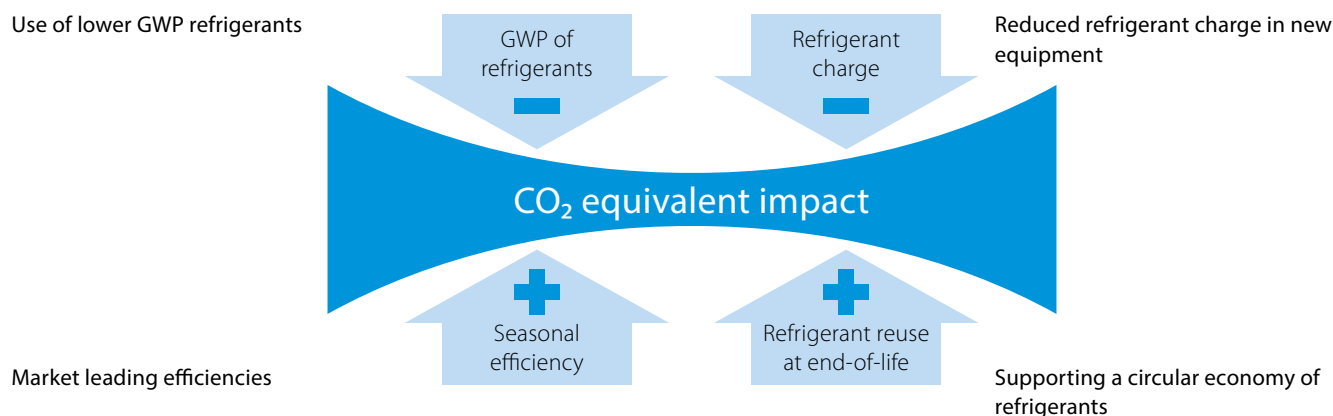

We support you with your next project:



Daikin Europe N.V. Naamloze Vennootschap Zandvoordestraat 300 • 8400 Oostende • Belgium • www.daikin.eu • BE 0412 120 336 • RPR Oostende (Publisher)



Place FSC label here
if applicable
(otherwise delete this box)

Printed on non-chlorinated paper
ECPEN25-605A 05/2025

The present publication is drawn up by way of information only and does not constitute an offer binding upon Daikin Europe N.V. Daikin Europe N.V. has compiled the content of this publication to the best of its knowledge. No express or implied warranty is given for the completeness, accuracy, reliability or fitness for particular purpose of its content and the products and services presented therein. Specifications are subject to change without prior notice. Daikin Europe N.V. explicitly rejects any liability for any direct or indirect damage, in the broadest sense, arising from or related to the use and/or interpretation of this publication. All content is copyrighted by Daikin Europe N.V.